



Water Supply System Optimization with CAD Systems Implementation – A multimodel Perspective

Abdul Firoze

Asst.Professor , Department of Mechanical Engineering

Amrita Sai Institute of Science and Technology ,Paritala , Kanchikacherla , Krishna ,A.P,India

ABSTRACT

The design of water supply systems is considered a combinatorial optimization task in which the diameter of each one of the pipes can be considered as a decision variable. The problem is to determine a set of diameters so that the cost function is minimized (depending on the length, diameter and material of the pipes) subject to hydraulic and commercial constraints. However, the chosen set of diameters will have a significant influence on the energy losses due to the hydraulic balance of the system. Therefore, it is necessary to use techniques that allow finding solutions that are viable under multiple criteria. In the present work the incorporation of the human factor in the decision-making process during the multi-objective optimization of the design of the water supply system is shown. The development of algorithms, products of the practical experience and implementation in CAD systems, influences the decrease of the search universe in the optimization as measured using the notation of India. Benefits provided by the CAD System to help the designer are presented. The paper ends with conclusion and recommendation of future works.

Keywords: decision-making, water supply, CAD system

I.INTRODUCTION

Due to its high cost the water supply systems are comparatively neglected areas in the rural areas of the developing countries. The mathematical modeling application with the incorporation of the human factor through computer packages allowing the authorities the chance to take preventive actions in the decision-making process. To solve combinatorial optimization problems, a wide variety of algorithms have been developed to try to solve them. These algorithms can be classified as accurate or approximate; While the former guarantee obtaining the optimum of any finite instance of the problem in a limited time, the latter place emphasis on obtaining satisfactory solutions in a short time. Since a large number of combinatorial problems are NP-Complete, the use of approximate algorithms is and will be an area of intense activity. In the last decades, special attention has been devoted to the optimal dimensioning of water distribution networks. To this end, various optimization techniques are applied that allow a greater reduction of the capital costs of these systems. Some of these methods are restricted in their application to branched networks. Such as, the Linear Programming model, are not applicable to the design of meshed networks that, due to the need to maintain the service in any circumstance, cannot be subject to the fragility of a single supply conduit per supply area, which requires considering circuits. The use of metaheuristics is based on problems whose solution is not satisfactory by traditional methods and the implementation of



exhaustive search methods is not justified in practice. So, it is applied with the objective of obtaining “good solutions” in a reasonable time.

The classic objective function is considered multimodal and concave (the stationary points are maximum). The minimum of this function are not stationary points as they are in the discontinuous-derivative. Although there are models that yield important results, most are limited to networks with few circuits due to the high consumption of computational resources and do not avoid the result of the network implicitly branched. Such a design solution is not feasible in practice because the objective of meshed distribution networks is to guarantee supply even if there are factors that affect it, such as: ruptures, maintenance, or other reasons. If any of these events occur in the sections of larger diameter pipes, the flow that must flow through it will not be efficiently driven by the smaller diameters, which were the result of the optimization to close the circuits. Many researchers use only investment costs during the formulation, energy costs are rarely taken into account and include a certain fixed pressure value in the supply node. For this reason, optimization leads to the “opening” of the circuits of the meshed network giving rise to branched or quasi- open networks. Other investigations devote efforts to consider the energy aspect, but are generally considered in terms of energy cost product to pumping, which implies, that the supply to the network is not by regulation.

The formulations that present such considerations do not allow to analyze other circumstances which are the most common in practice, as is the supply through tanks. On the other hand, classic optimization is based on a single efficiency indicator, the cost, with which it cannot be precisely specified, if the solution obtained is efficient from the energy point of view, when considering together with the variable costs, the fixed costs, which for the same design task, vary depending on the trajectory of the network and the combination of diameters for each section of pipe; both, in turn, influence the excavation volumes that are a function of the geological zones, the which are not usually uniform in a given physical space.

The energy loss to be considered includes the friction losses and the losses produced by singularities in the water distribution network, which will determine if the system performance, in a particular state, can be good because there is little loss of available energy ; or not so good, due to a large loss of available energy. The reduction of energy losses in a system is proportional to the guarantee of pressure height in the nodes; therefore, the minimization of this indicator is aimed at maximizing the benefit of excess pressure at the critical point.

There are attempts to minimize the obtaining of quasi-open networks in optimization processes, such as, to include within the objective function other indicators such as the reliability of the pipes, in which is considered the time that a pipeline must be isolated by some reason. Reliability is an indicator that can be quantified in various ways: take into account the type and aging of the pipes in the network, changes in demand or pressure, the type of soil, the seismic threat in the area, among other factors It can be measured from the surplus of pressure obtained in the nodes in relation to the minimum or admissible pressure value and also considers the uniformity of the diameters connected to a certain node. The increase in reliability allows the network to assume better behavior in the event of unforeseen events.



II. RESEARCH METHODOLOGY

A) HUMAN FACTOR IN THE DECISION-MAKING

The optimization process proposed is supported on a CAD application that guarantees a feasible solution by decreasing the tendency to open cycles, thereby obtaining circuits that increase the reliability of the network. One way of contemplating reliability in water distribution networks, without explicitly

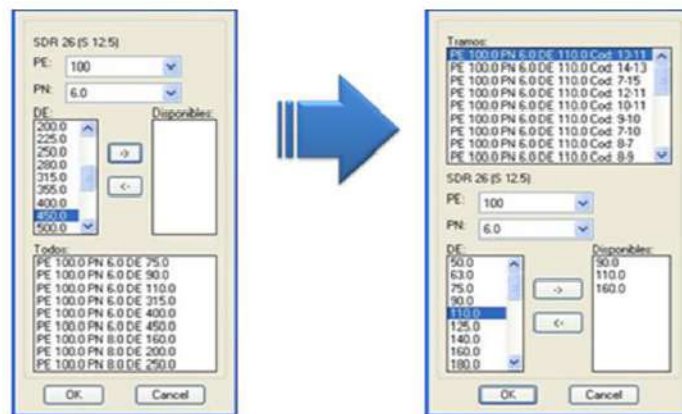


Figure 1: Shows Selection of the variants of diameters for each section of pipe

expressing it in the optimization model, is to ensure that the model cannot choose diameters with important dimensional differences for the sections of pipes that connect to the same node.

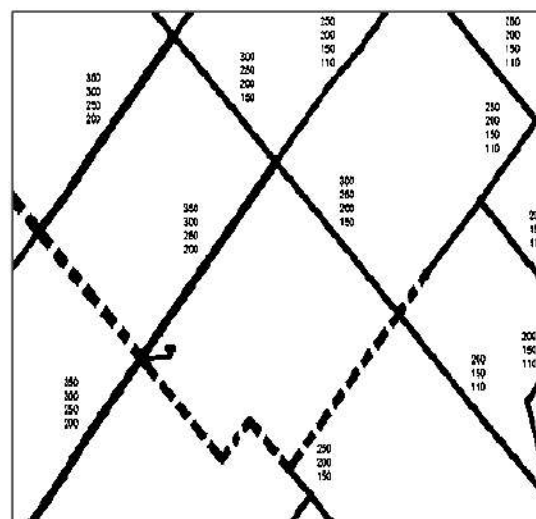


Figure 2: Shows Graphics benefits of a CAD system in the optimization process

The procedure that is conceived allows to choose from graphical advantages and CAD techniques a combination of diameters for each pipe section where the reliability of the circuits and other subjective aspects can be taken into account. Figure 1 shows the options of the CAD system to assign to each



section of pipe a logical combination of diameters, considering the proximity to the source of supply. In practice, it is known that those sections of pipes closest to the supply source will result in the largest diameters. These diameters will decrease as they move away from the supply. From graphics benefits you can visualize the different combinations of diameter assigned to the sections of pipes that make up the hydraulic network. It can also be highlighted which of the pipes are existing recognizing them by another type of line, while the colors and thicknesses allow the classification by type of material and diameter assigned respectively, see Figure 2.

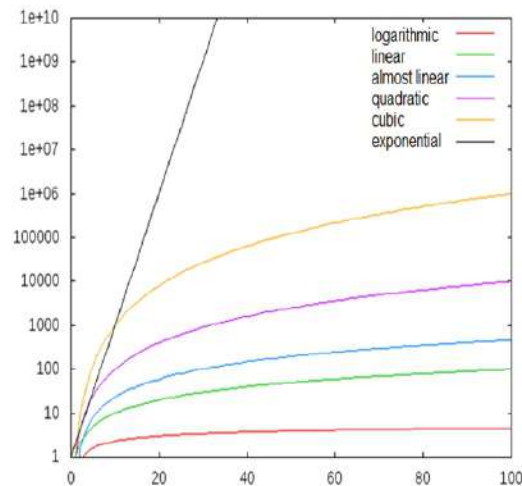


Figure 3 Growth rates according to the complexity of programming

Table 1 : Shows Relationship of the population with the diameter combination

No.	Options	Population	Increment	% vs. next
1	3	2,5E+33	-	2E-07
2	4	1,4E+42	1.39E+45	2E-05
3	5	8,5E+48	8,47E+48	3E-04
4	6	3E+54	2.96E+57	0,002
5	7	1,4E+59	1.44E+62	0,009
6	8	1,6E+63	1.65E+66	0,026
7	9	6,3E+66	6.26E+69	0,063
8	10	1E+70	9.99E+72	-

One of the most used schemes in recent years for the approximation of multiobjective function is the minimization of Tchebycheff's distance from an ideal solution (or desired) to the region of existence of the solution. Once the reliability is considered from the graphical advantages, the probability of obtaining a better compromise between the two efficiency indicators expressed previously is increased: energy loss (E) and total cost (C). The minimization of the weighted distance of Tchebych(Z) is expressed in 4 when each parameter is affected by a weight established by the designer. In this way, the quality function of the system is proposed by means of the following equation:



$$Z = \max \left\{ w_1 \frac{E - E^{id}}{E^{id}}, w_2 \frac{C - C^{id}}{C^{id}} \right\} \quad \text{-----(1)}$$

Where:

Z - Quality function.

E - Loss of energy in the network.

E^{id} - Ideal or desired energy loss.

C - Total cost of the network.

C^{id} - Ideal or desired total cost.

w₁ - Level of importance established for the energy efficiency indicator.

w₂ - Level of importance established for the cost efficiency indicator.

Calculation of penalties

Every water distribution network has certain restrictions in relation to the pressure height values at the nodes and the flow velocity in the sections. For the task under study, the following are considered:

1. Pressure (Node)
2. Speed (Sections)

The above restrictions are taken into consideration by calculating the value of a function *Pen*, of penalty, expressed according to the method of JN Kelley. The result of this function will increase significantly when the velocity and pressure values obtained do not correspond with the permissible parameters.

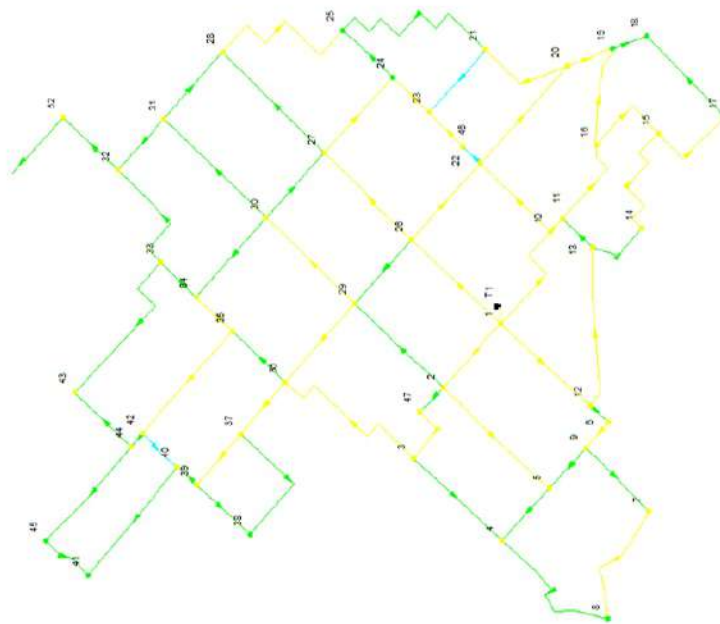


Figure 4: Shows Representation of the hydraulic simulation of a design variant



III. RESULTS AND DISCUSSION

In the doctoral thesis, the importance of integrating the stages of the water supply network design process in a single CAD system was demonstrated, which allowed to reduce project delivery times and increase the quality of the solutions obtained by decreasing the probability of committing human errors. Among the activities that were computerized, the following stand out:

Benefits provided by the CAD System to help the designer:

1. Projection of the design population.
2. Determination of the flow required by the water distribution network according to population, tourism and large consumers.
3. Generation of the triangular mesh that describes the prevailing topography in the locality.
4. Definition of geological zones classified by soil types and their depth.
5. Determination of the three-dimensional location of the nodes (Hechavarría et al., 2007b).
6. Determination of the lengths of the pipes according to the trajectory made by the designer and the irregularities of the terrain.
7. Selection of the type of material and dimensions of the pipes from the market offers.
8. Definition of the areas of supply based on data on population, housing or population density as well as the demand of tourism and/or large consumers.
9. Display of the classified information according to the hydraulic element that you want to analyze.
10. Obtaining the branched network that unites all the nodes of demand or supply by the minimum route (minimum network prioritized).
11. Generation of closed network variants according to permissible perimeters.
12. Proposal of variants of diameters for sections of pipes when considering the criteria of the designers and the presence of existing pipes (The experience of the designer is fundamental in the adequate decrease of the search universe, Table 1).
13. Generate a population of feasible solutions under technical- economic criteria that can be evaluated subjectively through its graphic representation inserted in the environment where it should work.

DISCUSSION :

The definition of variants of diameters for each section of pipe established in step 12 has a decisive influence on the optimization process, since the search population in the optimization process considerably reduced in step 13 decreases considerably. Table 1&2 show the results obtained of the hydraulic modeling performed on the network of Figure 4. The "Gradient Method" used for hydraulic balancing is classified as, a hybrid method of nodes and meshes and simultaneously solves the equations of continuity in the nodes and the hydraulic behavior equations of the pipelines for a given moment to call it. For the hydraulic balance, the Gradient Method was used.

It is an efficient method of hydraulic calculation that implements a model for the resolution of piping systems under pressure, represented by a system of linear equations expressed in matrix form. Its main advantage is that it avoids the assembly of matrices, which decreases the quantity of processes to be carried out in comparison with other methods (ie, Hardy-Cross, Raman's or Tong's equivalent pipe method, etc.).



As a quality criterion of the CAD application, exchange files are automatically generated that can be loaded in EPANET to evaluate the results of the hydraulic calculation.

Table 2 :Shows Results obtained in the pipe sections

No.	Section	Length <m>	Diameter <mm>	Flow <L/s>	Speed <m/s>	Unit losses <m/km>	Rugosity	Material*	Existing	Nominal diameter	Losses (m)
1	1-2	391,77	500	480,81	2,45	7,99	145	Fiberglass	1	500	3,13
2	2-5	671,26	184,6	32,55	1,22	6,99	145	HDPE	0	200	4,69
3	5-4	321,08	101,6	5,99	0,74	5,58	145	HDPE	0	110	1,79
4	4-8	706,35	101,6	8,85	1,09	11,48	145	HDPE	0	110	8,11
5	3-4	553,21	147,6	13,8	0,81	4,24	145	HDPE	0	160	2,35
6	7-8	587,27	101,6	10,79	1,33	16,59	145	HDPE	0	110	9,74
7	6-9	158,51	184,6	40,3	1,51	10,39	145	HDPE	0	200	1,65
8	9-7	407,64	230,8	20,3	0,49	0,98	145	HDPE	0	250	0,40
9	9-5	247,93	147,6	6,22	0,36	0,97	145	HDPE	0	160	0,24
10	12-6	111,46	230,8	40,3	0,96	3,5	145	HDPE	0	250	0,39
11	1-12	554,68	290,8	130,47	1,96	10	145	HDPE	0	315	5,55

IV.CONCLUSION

1. The energy losses (result of the hydraulic simulation) are included as an efficiency indicator in this proposal. In this way, energy efficiency can be properly evaluated during the design activity of the water distribution networks, independently of the supply system (injection or regulation).
2. During the hydraulic analysis, energy losses are traditionally represented in the pipe sections in a standardized manner (m/ km), however, the unit values cannot be considered as indicators of energy efficiency in optimization processes, due to that do not correspond to the real losses (see loss totals in Table 2). The inclusion of this new indicator, from the technical and non- economic point of view, allows to evaluate during the modeling, essential benefits such as the increase of the pressure in critical points, according to the variant of diameters chosen for each section of pipe.
3. The decrease in the number of options per diameter of pipes with the use of CAD technologies permit choosing variants of diameters according to the proximity of the source and without important dimensional differences for the sections of pipes that are connected to the same node, this guarantees the obtaining of reliable circuits that allow to increase the reliability of the network without having to consider it explicitly in the mathematical model as an indicator of efficiency, which increases the probability of obtaining better optimized options regardless of the heuristic that is applied.

REFERENCES:

- [1]Cheema PPS, Kaur P. Advocating integrated water resources management approach for rural human settlements. *Int J Hydro*. 2018;2(3):278–279.
- [2]Feil AA. Mathematical modelling for characterising and forecasting the water supplying system condition in Lajeado (RS). *Int J Hydro*. 2018;2(4):453–458.
- [3]Aliniya Z, Mirroshandel SA. A novel combinatorial merge-split approach for automatic clustering using imperialist competitive algorithm. *Expert Systems with Applications*. 2019;117:243–266.
- [4]López-Morales CA, Rodríguez-Tapia L. On the economic analysis of wastewater treatment and reuse for designing strategies for water sustainability: Lessons from the Mexico valley basin. *Resources, Conservation and Recycling*. 2019;140:1–12.



- [5]Hechavarría Hernández JR, Ruiz JA, Asgher U. Novel Multi-objective Optimization Algorithm Incorporating Decisions Factors in Design Modeling of Hydraulic Nets. In: Kantola J, Nazir S, Barath T, editors. *Advances in Human Factors, Business Management and Society*. AHFE 2018
- [6]Advances in Intelligent Systems and Computing. Springer; 2019:783:690–696.Das AK, Das AK, Sarkar A. An evolutionary algorithm-based text categorization technique. 2019.
- [7]Denysiuk R, Gaspar-Cunha A, Delbem ACB. Neuroevolution for solving multiobjective knapsack problems. *Expert Systems with Applications*. 2019:116:65–77.
- [8]Montero R, Legra A, Hechavarría J. Optimización operacional de redes hidráulicas para climatización centralizada de hoteles, Revista electrónica Ingeniería Hidráulica y Ambiental. Centro de Investigaciones Hidráulicas. CIH. CUJAE. Cuba: Riha; 2016. 37(2):3–17.
- [9]Li Z, Zhu E, Shao Z, et al. NP-completeness of local colorings of graphs.*Information Processing Letters*. 2018;130:25–29.
- [10]Hechavarría JR. *Optimización del diseño de redes de distribución de agua bajo criterios técnico-económicos*. Tesis Doctoral. Cuba: Universidad de Oriente; 2009.
- [11]Martínez JB. Quantifying the economy of water supply looped networks. *Journal American Society of Civil Engineers (ASCE)*. La Habana, Cuba; 2007.
- [12]Pirim H, Eksioğlu B, Glover FW. A novel mixed integer linear programming model for clustering relational networks. *Journal of Optimization Theory and Applications*. 2018;176(2):492–508.
- [13]Glover F, Kochenberger GA. *Handbook of Metaheuristics, Operations Research Management Science*. Kluwer Academic Publishers; 2003.
- [14]Vairavamoorthy K, Ali M. Optimal design of water distribution systems using genetic algorithms. *Comput Aided Civ Infrastruct Eng*. 2000;15(2):374–382.Martínez V, Monteagudo J, Jáuregui S. *Mecánica de los Fluidos y Máquinas de Flujo*. Cuba: Editorial UniversoSur, Universidad de Cienfuegos; 2007.



www.ijisea.org